

APP CRS

Rwy Idg

11494

TDZE

640

Apt Elev

645

036°

RNAV (RNP) X RWY 4R

DETROIT METROPOLITAN WAYNE COUNTY (DTW)


RNP AR APCH.

For uncompensated Baro-VNAV systems, procedure NA below -19°C (-2°F) or above 54°C (130°F). Simultaneous approach authorized.

ALSF-2

MISSED APPROACH: Climb to 4000 direct LUPAY and hold.

D-ATIS	DETROIT APP CON	METRO TOWER	GND CON	CLNC DEL	CPDLC
133.675	124.05 284.0	128.125 317.725	121.8 (NW) 119.45 (NE) 132.725 (SW) 119.25 (SE)	120.65	

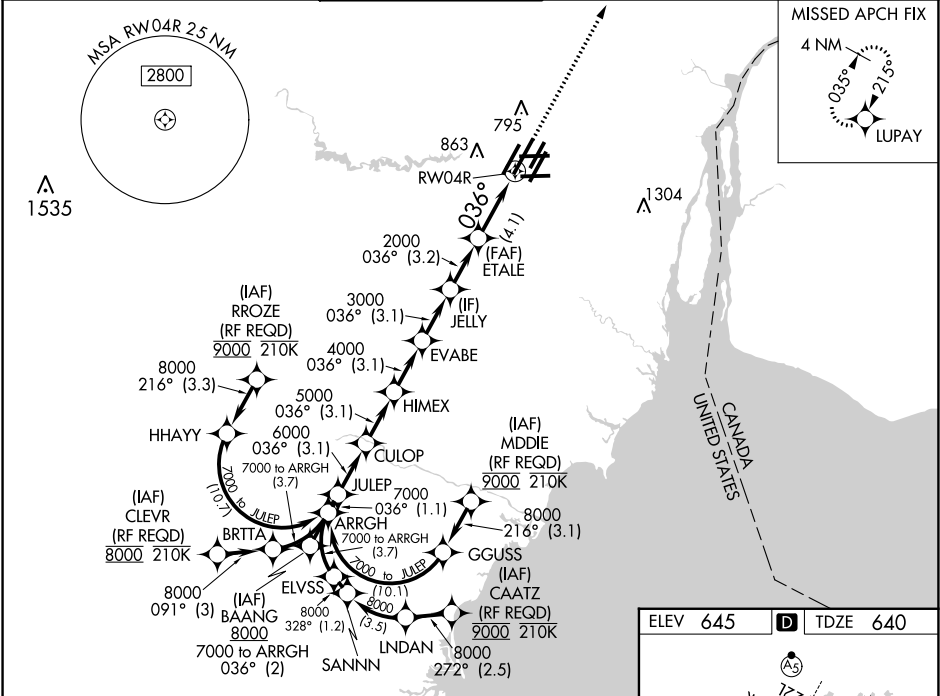

JULEP

7000

CULOP

6000

HIMEX

5000

EVABE

4000

JELLY

3000

ETALE

2000

RW04R

GP 3.00°

TCH 52

4000

LUPAY

036°

3.1 NM

3.1 NM

3.1 NM

3.1 NM

3.2 NM

4.1 NM

CATEGORY	A	B	C	D
RNP 0.30 DA	1031/35 391 (400-5%)			

AUTHORIZATION REQUIRED

ELEV 645

TDZE 640

TWR 877

REIL Rwy 3L, 9L, 9R and 21R

HIRL all runways