WAAS CH 72611 W32A	APP CRS 321°	Rwy Idg 6000 TDZE 122 Apt Elev 129

RNAV (GPS) RWY 32

CHARLES M SCHULZ-SONOMA COUNTY (STS)

RNP APCH.

T A For uncompensated Baro-VNAV systems, LNAV/VNAV NA below -4°C or above 54°C.
RVR 1800 authorized with use of FD or AP or HUD to DA.

MALSR

MISSED APPROACH: Climb to 6000 direct TUGUC and on track 308° to CABEX and hold, continue climb-in-hold to 6000.

ATIS	OAKLAND CENTER	SANTA ROSA TOWER★	GND CON	UNICOM
120.55	127.8 353.5	118.5 (CTAF) L 363.0	121.9	122.95

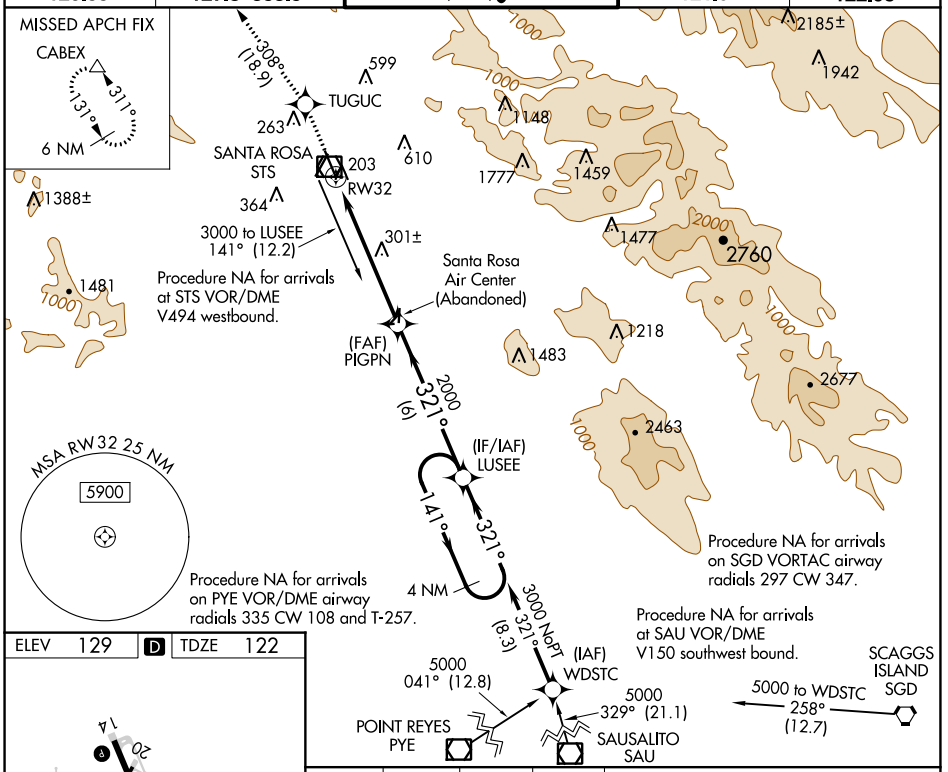

ELEV 129	D	TDZE 122

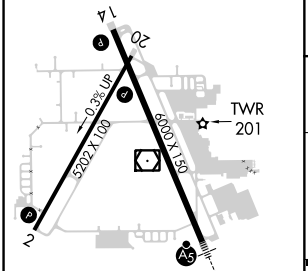

321° to RW32

MIRL Rwy 2-20 L
HIRL Rwy 14-32 L

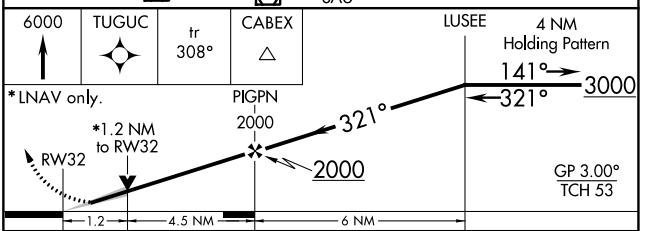

CATEGORY	A	B	C	D
LPV DA #	322/24		200 (200-½)	
LNAV/VNAV DA	570/50		448 (500-1)	
LNAV MDA	560/24	438 (500-½)	560/40	438 (500-¾)
C CIRCLING	600-1 471 (500-1)	680-1 551 (600-1)	1080-3 951 (1000-3)	1420-3 1291 (1300-3)

SW-2, 03 DEC 2020 to 31 DEC 2020
SW-2, 03 DEC 2020 to 31 DEC 2020