APP CRS		
077°	Rwy ldg	10000
	TDZE	29
	Apt Elev	29

RNAV (RNP) Y RWY 8

JACKSONVILLE INTL (JAX)

For uncompensated Baro-VNAV systems, procedure NA below -5°C (23°F) or above 54°C (130°F). GPS required. For inop MALSR, increase RNP 0.11 all Cats visibility to 1 mile, increase RNP 0.30 all Cats visibility to 1⅜ mile.

ALSF-2

MISSED APPROACH: Climb to 2000 on track 077° to YEJWO and hold.

D-ATIS	JACKSONVILLE APP CON	JACKSONVILLE TOWER	GND CON	CLNC DEL
125.85	119.0 269.9	118.3 317.7	121.9 348.6	119.5 290.275

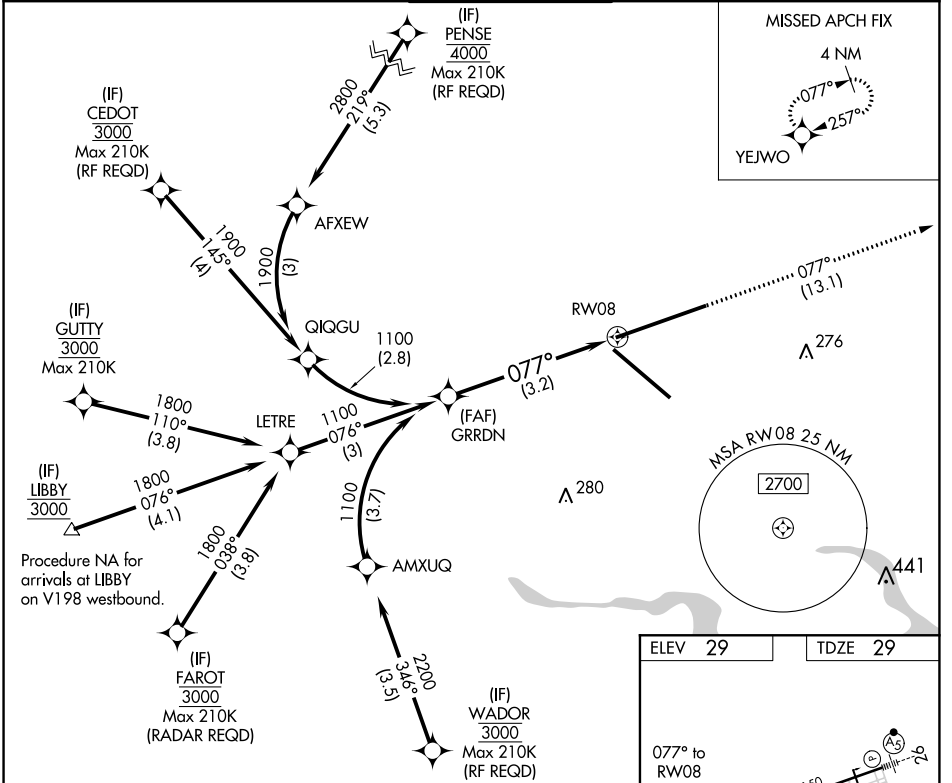

VGSI and RNAV glidepath not coincident (VGSI Angle 3.00/TCH 70).

2000 tr 077° YEJWO

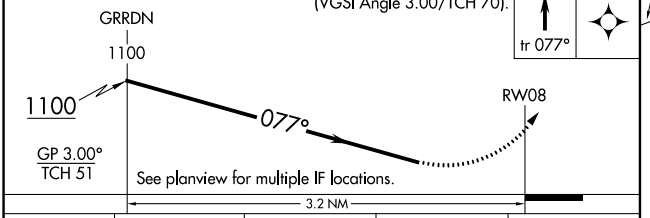

CATEGORY	A	B	C	D
RNP 0.11 DA		356/40	327 (400-¾)	
RNP 0.30 DA		426/45	397 (400-⅞)	

AUTHORIZATION REQUIRED

ELEV 29 TDZE 29

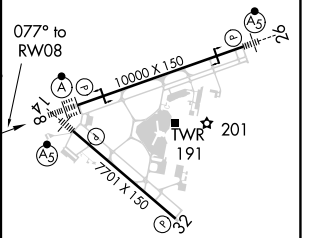

REIL Rwy 32
TDZ/CL Rwys 8, 14, and 26
HIRL Rwys 8-26 and 14-32

SE-3, 31 DEC 2020 to 28 JAN 2021
SE-3, 31 DEC 2020 to 28 JAN 2021